


Datový list | Objednáací číslo: 2002-472

Stupňovitý můstek; Izolováno; 2x; Jmenovitý proud 25 A; Vhodný k řadovým svorkám řad 2002 a 2003; Světle šedá

[www.wago.com/2002-472](http://www.wago.com/2002-472)

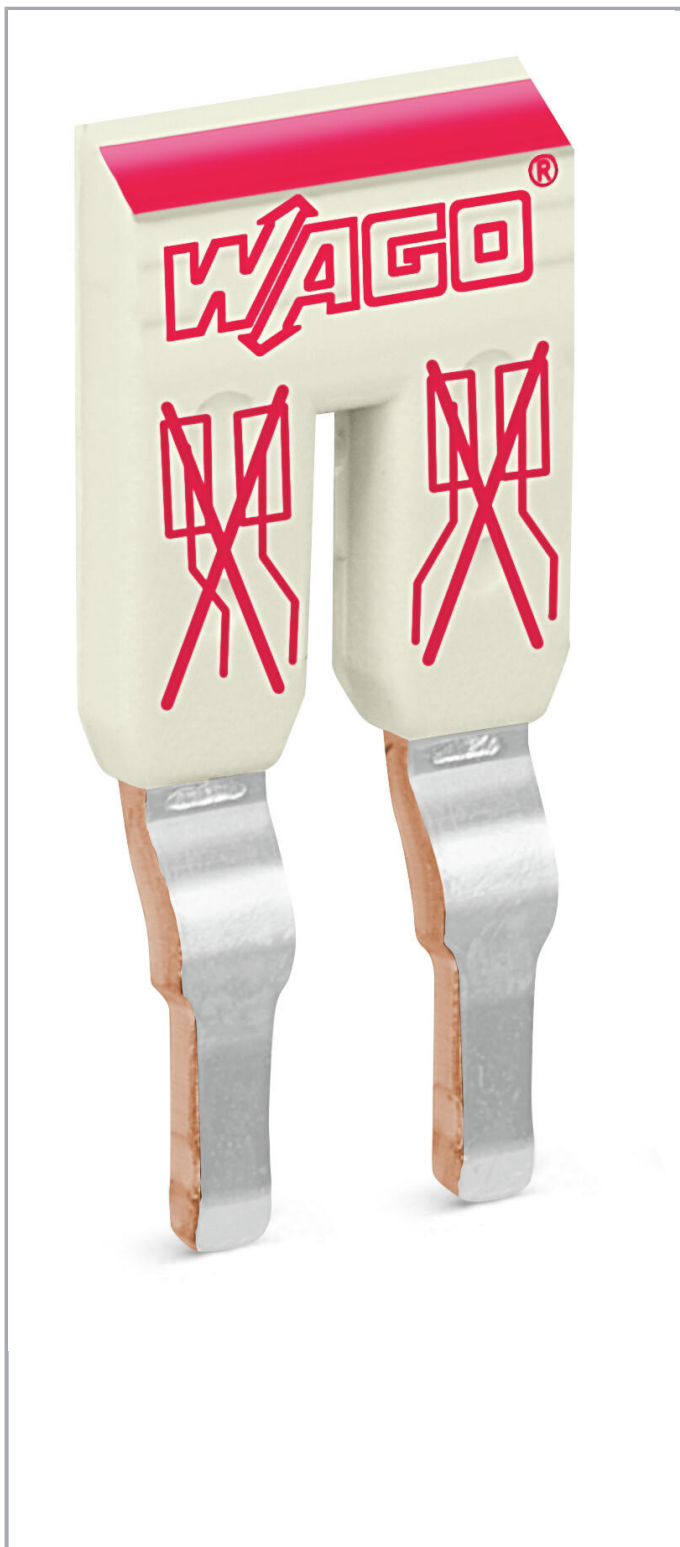

RoHS   
Compliant

BOMcheck.net

Barva: **Data****Elektrické parametry****Ratings per IEC/EN 60664-1**

Návrhové napětí (III / 3)	400 V
Návrhové rázové napětí (III / 3)	6 kV
Jmenovitý proud	25 A

**Geometrické údaje**

Šířka	9 mm / 0.354 inch
-------	-------------------

**Údaje o materiálu**

barva	Světle šedá
Požární zatížení	0.032 MJ
Hmotnost	0.94 g

**Obchodní údaje**

Product Group	22 (TOPJOB S)
Druh balení	bag
Country of origin	DE
GTIN	4055143692250
Customs Tariff No.	85366990990

**Ke stažení****Documentation****Additional Information**

Technical explanations	03-Apr-2019	pdf 2,1 MB	Stáhnout
------------------------	-------------	---------------	----------

**CAD/CAE-Data****CAD data**

2D/3D Models 2002-472	URL	Stáhnout
-----------------------	-----	----------




CAE data

WSCAD Universe 2002-472

Stáhnout

## Handling Instructions

### Jumpered

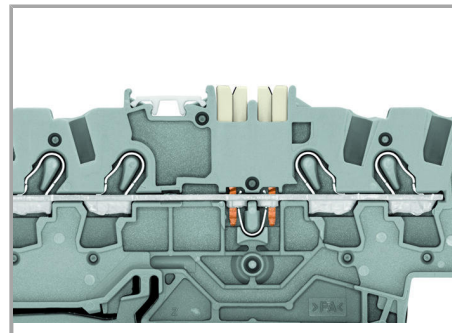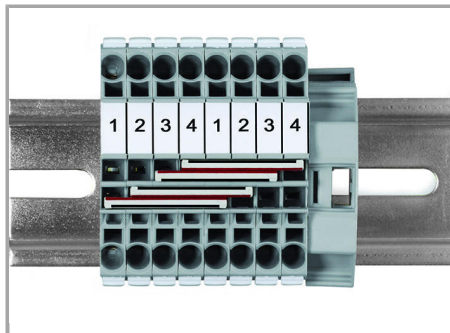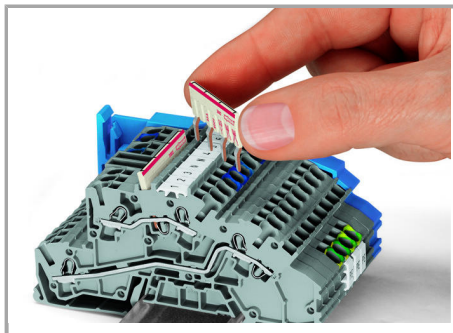


Locate red stripes of the staggered jumpers on the inside.

Commoning two potentials in one single jumper slot via extremely slim staggered jumpers.

2 Brückerspuren in einer Klemme

Insert staggered jumper and push down until it hits backstop.


### Jumpered

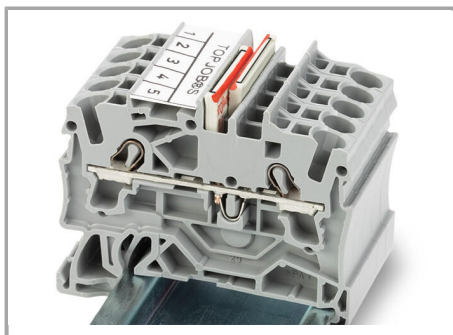

Locate red stripes of the staggered jumpers on the inside.

Insert staggered jumper and push down until it hits backstop.


### Jumpered

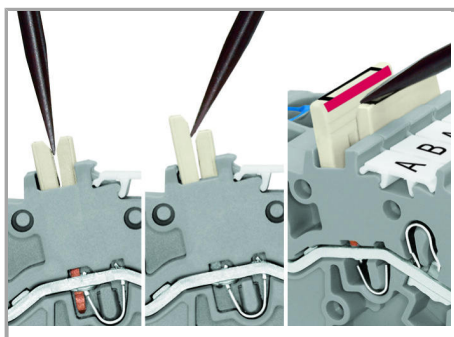

Removing a staggered jumper:


Insert the operating tool between the staggered jumpers, then lift up the jumper.

#### Jumpered

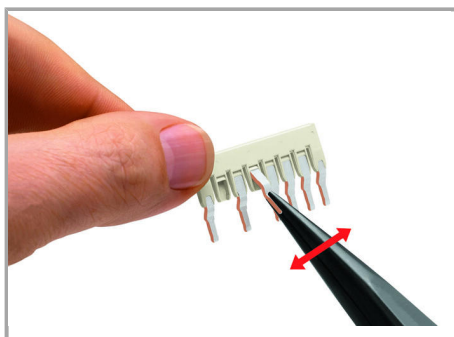


Staggered jumper (seven contacts)

Individual jumper contacts can be broken off by bending them. The remaining piece of insulation will meet requirements for clearances and creepage distances.

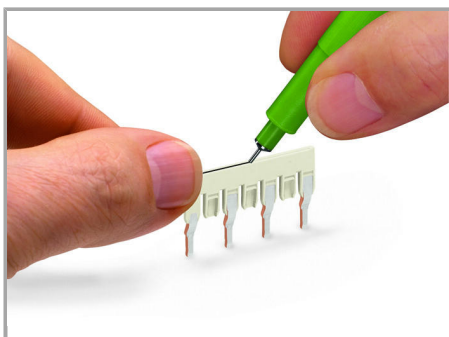

Marking a staggered jumper using a felt-tip pen.

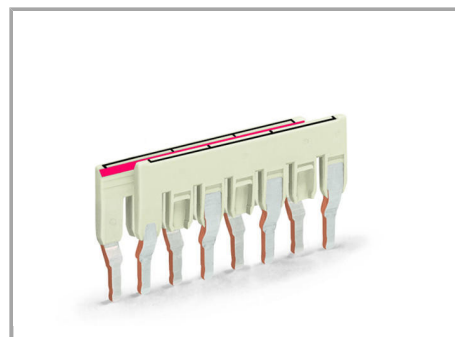

Staggering jumpers in a single jumper slot.

When creating custom staggered jumpers (e. g., for bridging over a terminal block with a different potential), make sure that only one contact lug is in contact with the terminal block.

The contact lugs of the customized staggered jumpers contact the terminal blocks via the gaps created in the second jumper.

Insert and press the ready-made jumper assembly into the jumper slot until it hits backstop.

#### Produktová rodina



### TOPJOB® S

TOPJOB® S: In various industrial applications and modern building installations, WAGO's wide and versatile range of rail-mount terminal blocks provides more than just reliable electrical connections.

[Zobrazit všechny produkty z rodiny](#)

Změny vyhrazeny.

---

WAGO Elektro spol. sr. o.  
Rozvodova 1116/36  
143 00 Praha 12 - Modřany  
Tel.: +420 261 090 143  
Email: [info.cz@wago.com](mailto:info.cz@wago.com), [wago-cz@wago.com](mailto:wago-cz@wago.com)

Máte otázky ohledně našich produktů?  
Kdykoli nám zavolejte na číslo +420 261 090 143.